



Detalhe Quadro e Diagrama Unifilar

Quadro de Cargas de Climatização - QDAR-01											
Quadro	Circuito	Descrição	Potência (W)	Potência (VA)	Fator Potência	Fator Demanda	Tensão (V)	Corrente (A)	Fase (mm²)	Neutro (mm²)	Terra (mm²)
QDAR 1			3280.00	3500.00	0.94	0.90	3150.00	14.32	4.0	4.0	4.0
QDAR 2			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 3			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 4			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 5			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 6			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 7			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 8			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 9			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 10			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 11			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 12			3280.00	3500.00	0.94	0.90	3150.00	220.00	14.32	4.0	4.0
QDAR 01 SOMA			39.360.00	42.000.00	0.94	0.90	37.800.00	380.00	57.50	16	16

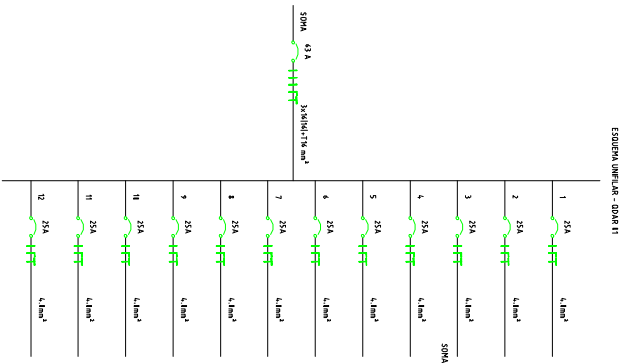

Quadro de Cargas de Climatização - QDAR-02											
Quadro	Circuito	Descrição	Potência (W)	Potência (VA)	Fator Potência	Fator Demanda	Tensão (V)	Corrente (A)	Fase (mm²)	Neutro (mm²)	Terra (mm²)
QDAR 1			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 2			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 3			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 4			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 5			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 6			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 7			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 8			3280.00	3500.00	0.94	0.90	3500.00	220.00	14.32	4.0	4.0
QDAR 02 SOMA			26.240.00	27.915.00	0.94	1.00	27.915.00	380.00	42.46	16	16

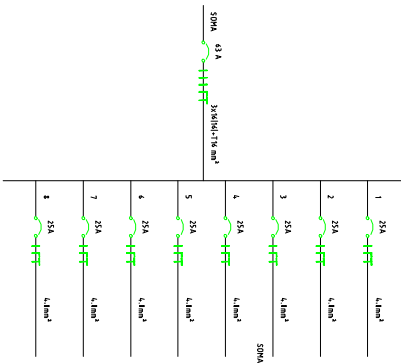

Universidade Federal da Paraíba

11/2010 Reestruturação Elétrica para Climatização do CCJ

0404